

4-12-2010

Rooftop Ventilator Senior Design Project

Gavin Moody

Department of Mechanical & Biomedical Engineering, Boise State University

Nick Thompson

Department of Mechanical & Biomedical Engineering, Boise State University

Jon Flack

Department of Mechanical & Biomedical Engineering, Boise State University

Solar Rooftop Ventilator


Team: Jon Flack, Gavin Moody, Nick Thompson
Faculty: James Ferguson Steve Hatten

Overview

Sunlight heats the rooftop via radiation. The surface temperature rises, and then heats the attic space via conduction and convection.

Heat Trapped in the attic adds to the heat load taken on by the home air conditioner.

Lowering the temperature in the attic space will reduce the load on the air conditioner.

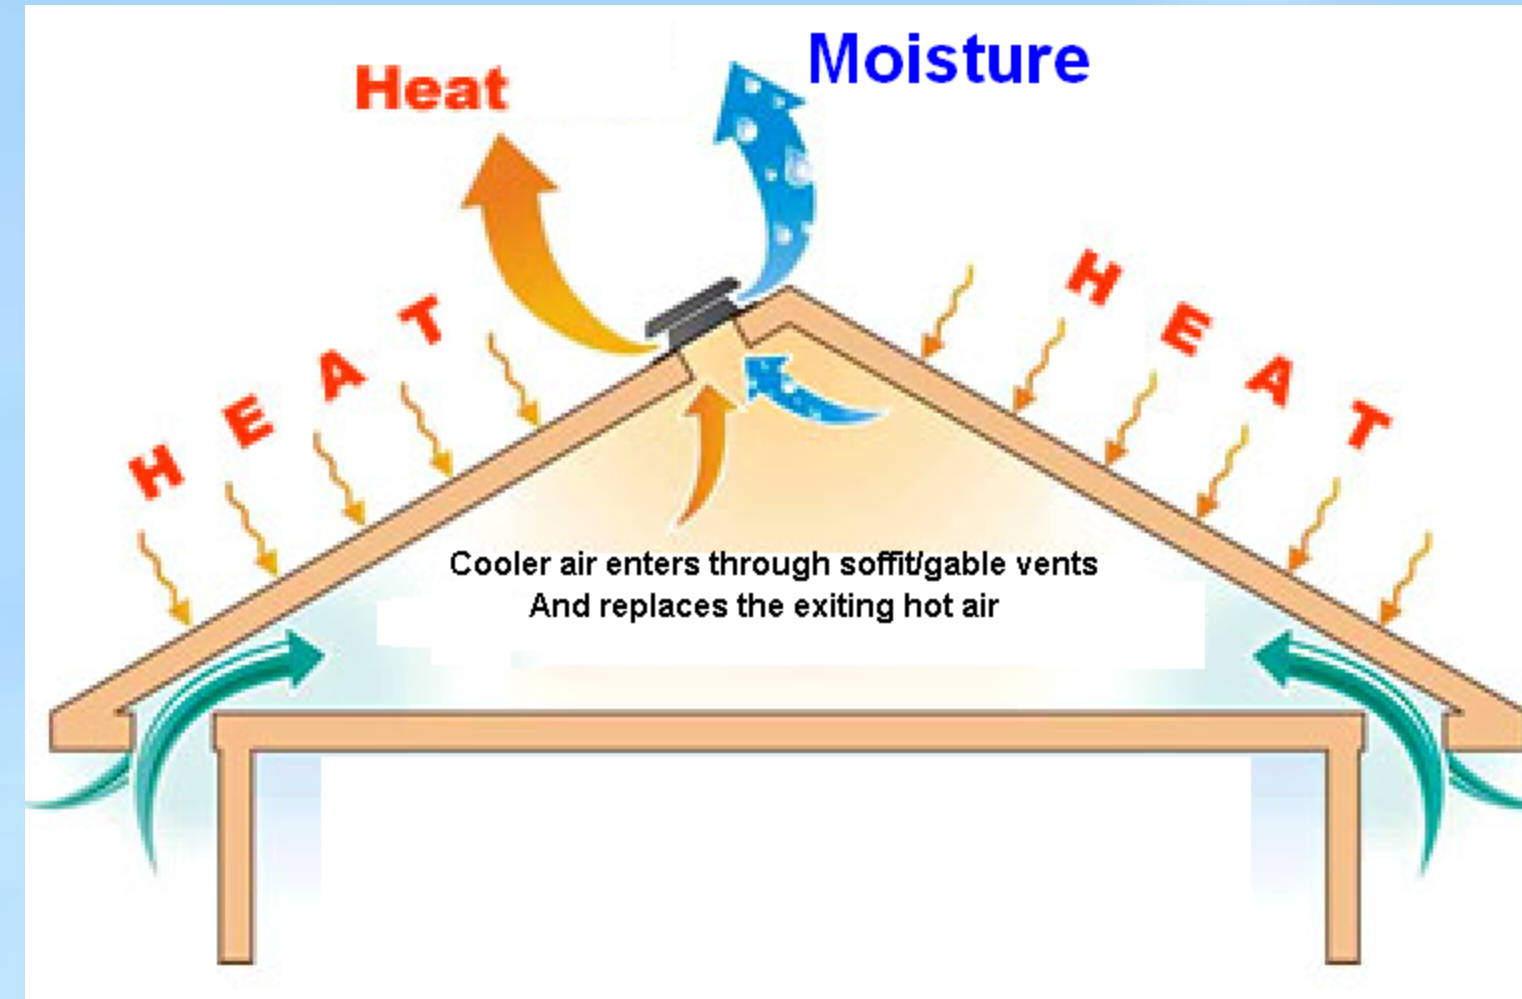


This simple diagram shows the energy paths defined by the problem.

$$Ra_L = Gr_L Pr = \frac{g\beta(T_s - T_\infty)L^3}{\nu\alpha}$$

$$Nu_L = \frac{hL}{k} = 0.27Ra_L^{\frac{1}{4}}$$

$$h = \frac{Nu_L k}{L}$$

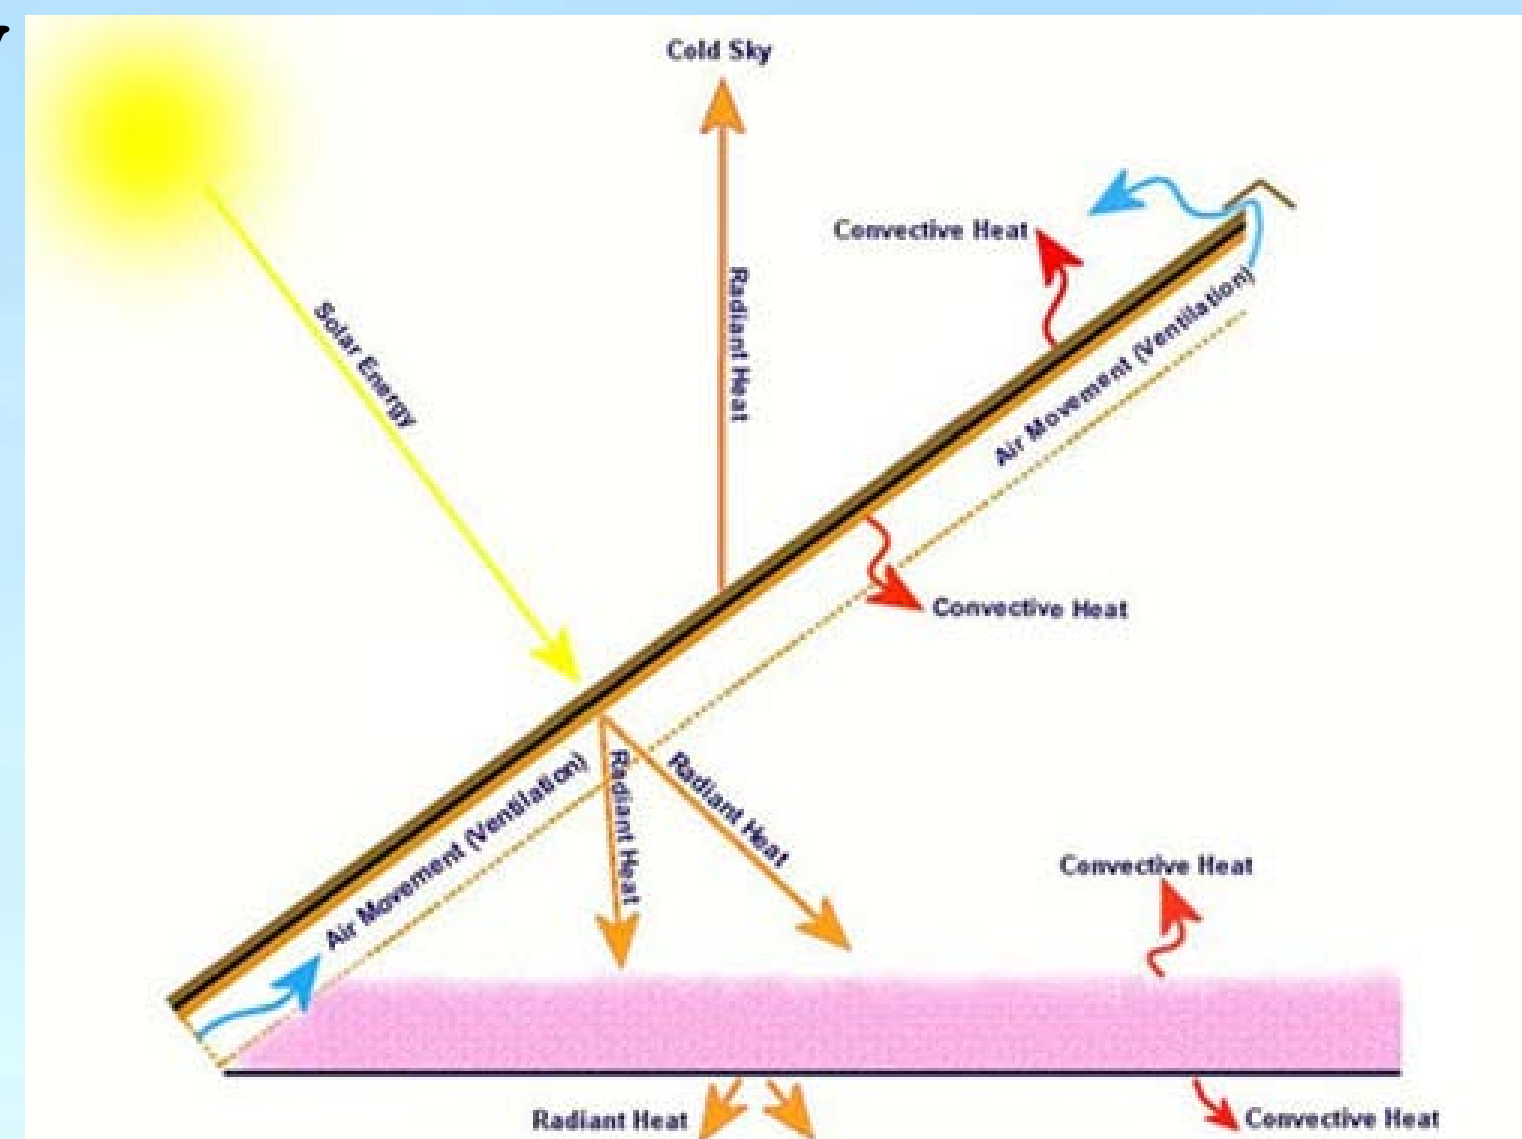

Using these correlations and a thermal resistive network the amount of heat transferred into the living space can be calculated.

Modeling for the different surfaces was completed using Natural Convection relationships for flow over a flat plate. Steps:

- Rayleigh number from Grashoff and Prandtl numbers
- Nusselt number from Rayleigh number
- Convection Coefficient from Nusselt number relation

Passive vs. Powered

There are two basic ways to ventilate an attic.

Either passively via natural convection, or powered ventilation, both utilizing various vents around the perimeter of the attic.

Passive

Pros:

- No electrical power used
- No wiring need

Cons:

- Inconsistent
- Will ventilate when not needed
- Need large amount of roof penetrations

Powered

Pros:

- Can be controlled via thermostat
- More reliable
- Constant output
- Thus, ensuring proper ventilation


Cons:

- Needs electrical wiring in the attic
- Takes electrical power (\$\$)

There is a large temperature difference between the attic air space, and the outside air on a sunny day.

The higher the temperature is in the attic space, the more heat that will transfer into the living space.


Natural convection keeps the maximum temperature below a critical point, but does not keep it very low in comparison

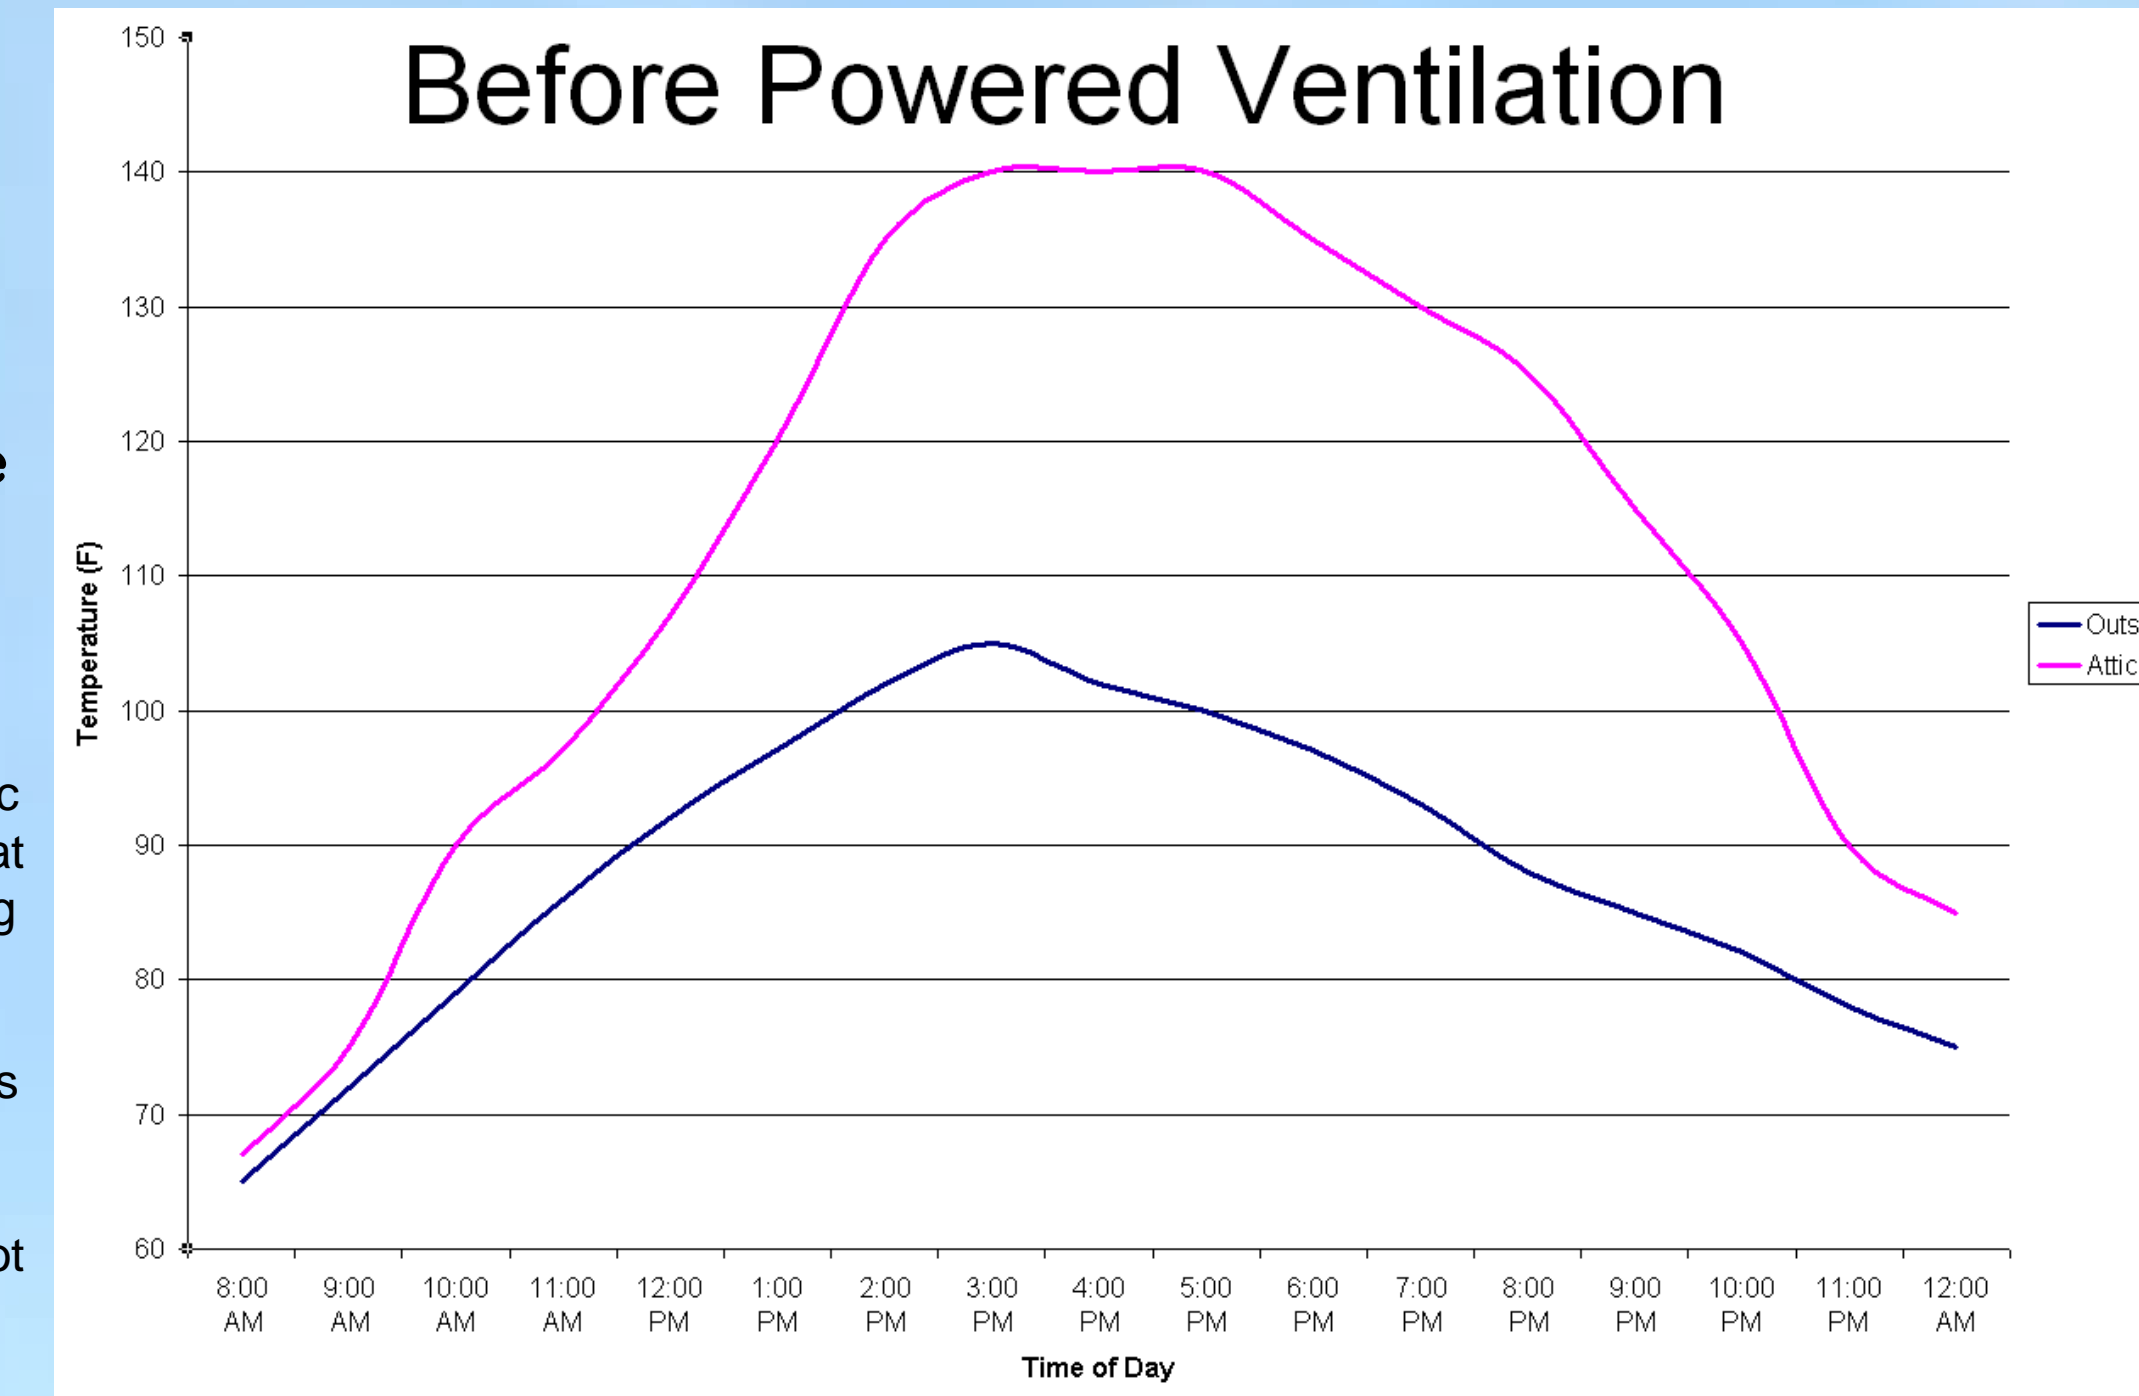

With powered ventilation (thermostatically controlled at 90F), the temperature difference is able to be lowered dramatically.

The higher the temperature is in the attic space, the more heat that will transfer into the living space.

Natural convection keeps the maximum temperature below a critical point, but does not keep it very low in comparison

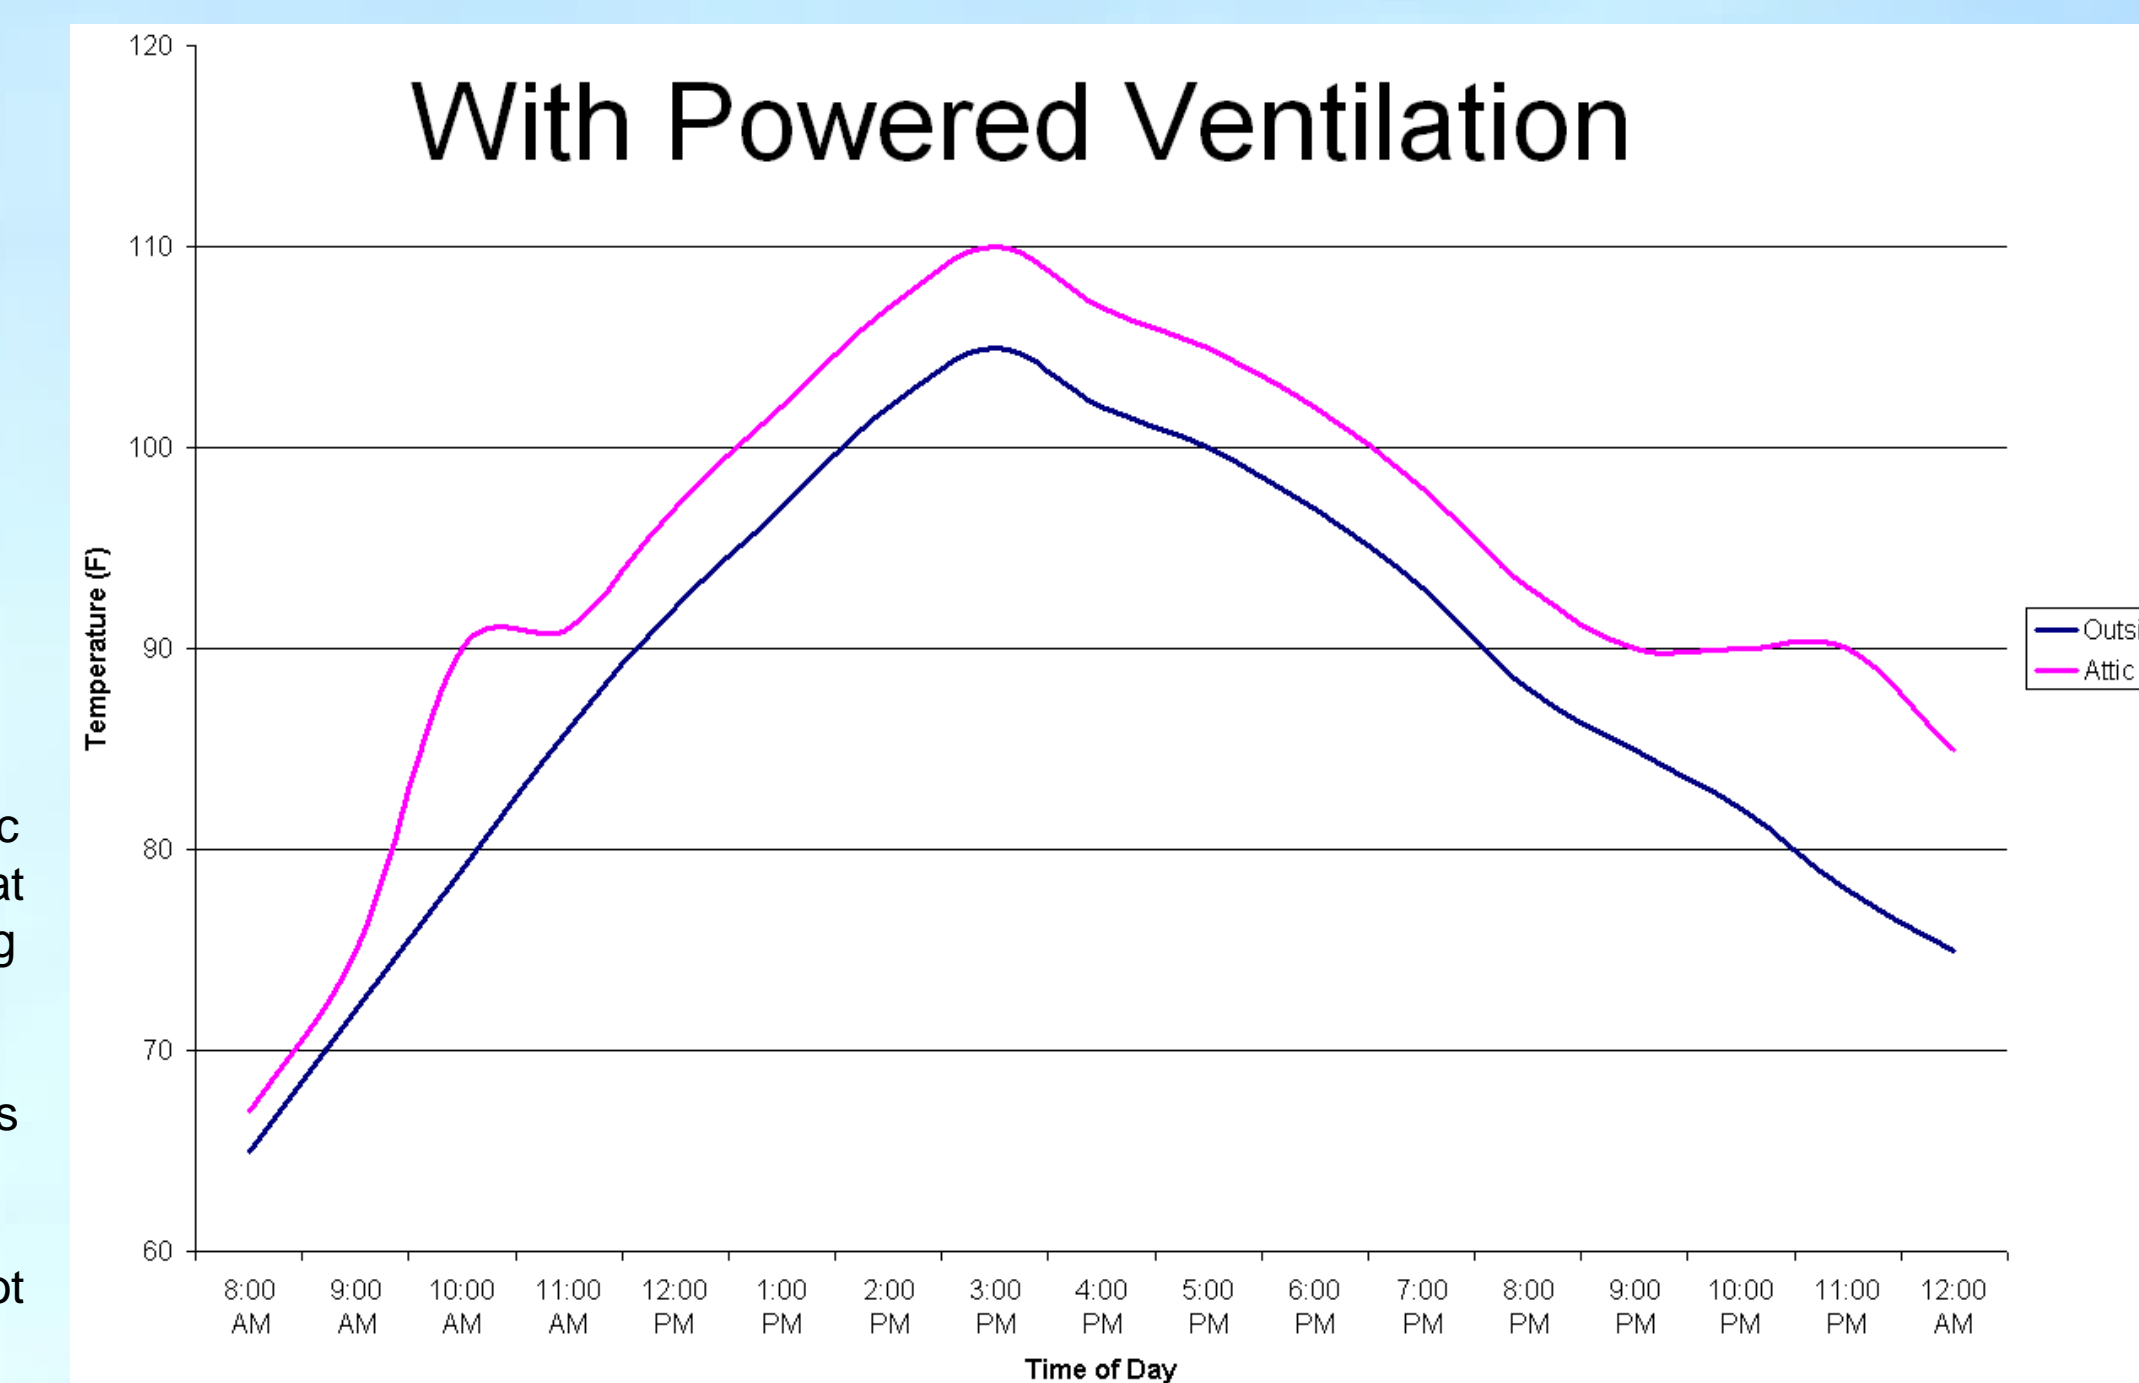

Solar vs. Household Current

Two of the ways considered to power the ventilator are via Solar and Household Current. There are Pros and Cons of each

Solar

Pros:

- FREE
- Self contained
- Low voltage (safe)

Cons:

- Require light source
- Inefficient
- Relative High Cost
- Low voltage (eff.)

Household Current

Pros:

- Constant Source
- More efficient
- Reliable

Cons:

- Uses household electricity
- Electrician Needed

Conclusion



Curling shingles, and attic mold are results of poorly ventilated attic spaces.

Powered ventilation is a great way to ensure proper attic ventilation. It will decrease attic temperature, and moisture, and thus increase the life of material in the attic/roof space. However, the most cost effective way to decrease the load on household air conditioning is proper insulation. Powered ventilation is still beneficial, as long as the energy cost is low.



Proper attic Insulation - R-38 about 15" of insulation.

Though solar powered ventilators have a much larger initial cost (off the shelf), they will save money immediately, due to ease of installation (self contained), as well as over time due to the energy (solar) being "free".

Here is an Arctic Breeze™ solar powered attic ventilator. This will be very close to the design of our unit due to its compactness, ease of installation, and that FAMCO already produces the unit, minus the fan and panel.

